



NEMO|etc.

Certificate of Authorization #32455
353 Christian Street, Unit #13
Oxford, CT 06478
(203) 262-9245

ENGINEER

TEST

CONSULT

P.E. EVALUATION REPORT (PEER)

GAF

1 Campus Drive
Parsippany, NJ 07054
(800) 766-3411

PEER-GAF-006.B.R13

FL20663-R22 (HVHZ)

Date of Issuance: 01/29/2021

Revision 13: 01/29/2025

SCOPE:

This P.E. Evaluation Report (henceforth 'PEER') is issued under **F.A.C. Rule 61G20-3** and the applicable rules and regulations governing the use of construction materials in the State of Florida. The documentation submitted has been reviewed by Robert Nieminen, P.E. for use of the product under the Florida Building Code. The product described herein has been evaluated for compliance with the **8th Edition (2023) Florida Building Code, High Velocity Hurricane Zone (HVHZ)** [sections noted herein](#).

DESCRIPTION: GAF Liquid Applied Roof Systems (HVHZ)

LABELING: Labeling shall be in accordance with the requirements of the Accredited Quality Assurance Agency noted herein.

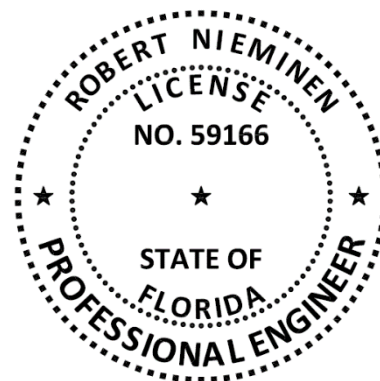
CONTINUED COMPLIANCE: This PEER is valid until such time as the named product(s) changes, the referenced Quality Assurance or production facility location(s) changes, or Code provisions that relate to the product(s) change. Acceptance of our PEERs by the named client constitutes agreement to notify NEMO ETC, LLC of any changes to the product(s), the Quality Assurance or the production facility location(s). NEMO ETC, LLC requires a complete review of its PEER relative to updated Code requirements with each Code Cycle.

ADVERTISEMENT: "NEMO P.E. Evaluated" may be displayed in advertising literature. If any portion of the PEER is displayed, then it shall be in its entirety.

INSPECTION: Upon request, a copy of this entire PEER shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This PEER consists of pages 1 through 5, plus 8-pages of Appendix.

Prepared by:



CERTIFICATION OF INDEPENDENCE:

1. NEMO ETC, LLC does not have, nor does it intend to acquire or will it acquire, a financial interest in any company manufacturing or distributing products it evaluates.
2. NEMO ETC, LLC is not owned, operated or controlled by any company manufacturing or distributing products it evaluates.
3. Robert Nieminen, P.E. does not have nor will acquire, a financial interest in any company manufacturing or distributing products for which the PEERs are being issued.
4. Robert Nieminen, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.
5. This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this PEER, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.

©2018 NEMO ETC, LLC

ROOFING SYSTEMS EVALUATION:
1. SCOPE:

Product Category: Roofing
Sub-Category: Liquid Applied Roof Systems
Product Approval Method: Method 1, Option D: Codified Material, Evaluation by Engineer
Compliance Statement: **GAF Liquid Applied Roof Systems**, as produced by **GAF**, has demonstrated compliance with the following sections of the **8th Edition (2023) Florida Building Code, High Velocity Hurricane Zone (HVHZ)** through testing in accordance with the following Standards. Compliance is subject to the [Installation Requirements](#) and [Limitations of Use](#) set forth herein.

2. STANDARDS:

| SECTION | PROPERTY | STANDARD |
|---------|-------------------------------|-----------------------------|
| TAS 110 | Resistance to Foot Traffic | TAS 114, Section 8.9 |
| TAS 110 | Wind resistance | TAS 114, Appendix C, D or J |
| TAS 110 | Susceptibility to Hail Damage | TAS 114, Appendix F |
| TAS 110 | Susceptibility to Leakage | TAS 114, Appendix G |
| TAS 110 | Material standard | ASTM D6163, D6164, D6222 |
| TAS 110 | Material standard | ASTM D6083 |

3. REFERENCES:

| ENTITY | EXAMINATION | REFERENCE | DATE |
|--------------------|----------------------------|----------------------|----------|
| NEMO (TST6049) | ASTM D6083, Table 1 (IL) | 4p-GAF-SSLAP-001.A | 05/29/24 |
| NEMO (TST6049) | Physical Properties | 4j-GAF-SSUDL-004.A | 11/19/24 |
| NEMO | Various PPT | PEER-GAF-007.A&B | Current |
| PRI (TST 5878) | Physical Properties (AZ) | GAF-679-02-01 | 05/31/16 |
| PRI (TST 5878) | Physical Properties (C-SC) | GAF-680-02-01 | 05/31/16 |
| PRI (TST 5878) | Physical Properties (S-SC) | GAF-676-02-01 | 05/31/16 |
| PRI (TST5878) | ASTM D6083, FIN (SC) | GAF-777-02-01 | 09/15/17 |
| PRI (TST5878) | ASTM D6083, FIN (AZ) | 376T0159 | 08/31/21 |
| PRI (TST 5878) | ASTM D6083, Table 2 (IL) | 743T0014 | 07/31/20 |
| PRI (TST 5878) | PDS Verify | 376T0340 | 10/28/22 |
| PRI (TST 5878) | PDS Verify | 376T0341 | 10/28/22 |
| ERD (TST6049) | TAS 114 | 4697-12-00-1 | 12/07/00 |
| ERD (TST6049) | TAS 114 | GAF-SC10845.04.16 | 04/26/16 |
| FM (TST 1867) | FM 4470 | 3000150 | 09/01/99 |
| FM (TST 1867) | FM 4470 | RR204846 | 05/09/16 |
| FM (TST1867) | FM 4474 | PR457312 | 04/20/21 |
| FM (TST1867) | FM 4474 | PR460126 | 09/20/22 |
| FM (TST1867) | FM 4474 | RR241387 | 05/10/24 |
| FM (TST1867) | FM 4474 | PR468153 | 11/04/24 |
| NEMO (TST6049) | FM 4474 | 4a-GAF-22-LSWUS-01.A | 04/26/23 |
| NEMO (TST6049) | FM 4474 | 4a-GAF-22-LSWUS-01.B | 04/27/23 |
| NEMO (TST6049) | Criticality | 4i-GAF-SSCRT-001.A | 05/29/24 |
| NEMO (TST6049) | TAS 114 | 4a-GAF-SSWUS-001.A | 07/24/24 |
| NEMO (TST6049) | Criticality | 4i-GAF-SSCRT-002.A | 12/10/24 |
| PRI (TST5878) | TAS 114 | GAF-462-02-11 | 07/01/14 |
| PRI (TST 5878) | TAS 114 | QCP-018-02-01 | 10/16/14 |
| PRI (TST5878) | TAS 114 | 376T0066 | 07/09/20 |
| PRI (TST 5878) | TAS 114 | 376T0339 | 01/20/23 |
| FM (CER1840) | TAS 114, Section 8.9 | RoofNav Listings | Current |
| UL, LLC. (QUA9625) | Quality Control | Service confirmation | 07/12/22 |
| UL, LLC. (QUA9625) | Quality Control | Florida BCIS | Current |

4. PRODUCT DESCRIPTION:

This PEER covers the **GAF Liquid Applied Roof Systems** applied to Approved substrates as outlined in the [Limitations of Use](#) herein. The following products make up the subject roof covers.

| TABLE 1: EVALUATED COMPONENTS | | | | | |
|-------------------------------------|---|--------------------|------|-------|--------------|
| TYPE | PRODUCT | MATERIAL STANDARD | | | PLANT(S) |
| | | REFERENCE | TYPE | GRADE | |
| LIQUID APPLIED MEMBRANE COMPONENTS: | GAF Premium Acrylic HydroStop® Top Coat | ASTM D6083 | I | N/A | AZ, SC |
| | GAF Surface Seal SB Thermoplastic Rubber Coating | ASTM D6083 | I | N/A | IL |
| | GAF Premium Acrylic HydroStop® Base Coat | N/A (not codified) | N/A | N/A | AZ, SC |
| | GAF Premium Fabric | | | | SC |
| SURFACING: | GAF TrafficCoat Pedestrian Surface Coating (Smooth or Textured) | N/A (not codified) | N/A | N/A | AZ |
| VAPOR BARRIER MEMBRANES: | GAFLAS® #75 Base Sheet | ASTM D4601 | II | N/A | AL, CA-F, GA |
| | Tri-Ply® #75 Base Sheet | | II | N/A | AL, CA-F, GA |
| | GAFLAS® #80 Ultima Base Sheet | | II | N/A | AL, GA |
| | GAFLAS® Ply 4 | ASTM D2178 | IV | N/A | AL, CA-F, GA |
| | Tri-Ply Ply 4 Ply Sheet | | IV | N/A | AL, CA-F, GA |
| | GAFLAS® Ply 4 M | | IV | N/A | AL |
| | GAFLAS® FlexPly™ 6 | | VI | N/A | AL, GA |
| | GAFLAS® FlexPly™ 6 M | | VI | N/A | AL |
| | Ruberoïd® 20 Smooth | ASTM D6163 | I | S | AR |
| | Ruberoïd® HW 20 Smooth | | I | S | AR |
| | Ruberoïd® HW 25 Smooth | | I | S | GA |
| | Ruberoïd® HW 30 Smooth | | I | S | AR |
| | Ruberoïd® 30 Granule | | I | G | GA |
| | Ruberoïd® HW Smooth | ASTM D6164 | I | S | GA |
| | Ruberoïd® Mop Smooth | | I | S | GA |
| | Ruberoïd® Mop Smooth 1.5 | | I | S | GA |
| | Ruberoïd® Mop Plus Smooth | | I | S | GA |
| | Liberty™ SBS Self-Adhering Cap Sheet | | I | G | AR, GA |
| | Ruberoïd® HW Granule | | I | G | GA |
| | Ruberoïd® Mop Granule | | I | G | CA-S, GA |
| | Ruberoïd® HW Plus Granule | | II | G | GA |
| | Ruberoïd® Mop Plus Granule | | II | G | GA |
| | Ruberoïd® Torch Smooth | ASTM D6222 | I | S | CA-S, GA, IN |
| | Ruberoïd® Torch Granule | | I | G | CA-S, GA, IN |
| | GAF SA Vapor Retader XL and XL40 | N/A | N/A | N/A | IN |

5. LIMITATIONS:

- 5.1 This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this PEER, or previous versions thereof, is/was used for permitting or design guidance. PEERs are not to be construed as representing any attributes not specifically listed, nor are PEERs to be construed as an endorsement of the subject, or a recommendation for its use. There is no warranty by NEMO ETC, LLC or Robert Nieminen, P.E., express or implied, as to any finding or other matter in this PEER, or as to any product covered by the PEER.
- 5.2 This PEER is exclusively for use in High Velocity Hurricane Zone jurisdictions, as defined in FBC Chapter 2 (Broward and Miami-Dade Counties).
- 5.3 The evaluation herein pertains to above-deck roof components; deck-attachment details pertain to 'as-tested' conditions under [Testing Application Standard TAS 114, Appendix J](#). Roof decks shall be in accordance with **FBC HVHZ** requirements to the satisfaction of the Authority Having Jurisdiction.
- 5.4 This PEER does not include evaluation of fire classification. Refer to **FBC HVHZ 1516** for requirements and limitations regarding roof assembly fire classification. Refer to **FBC 2603** for requirements and limitations concerning the use of foam plastic insulation.
- 5.5 This PEER does not include evaluation of roof edge termination. Refer to [Roofing Application Standard RAS 111](#) for requirements and limitations regarding edge securement for low-slope roofs.
- 5.6 Refer to **FBC HVHZ 1521** for requirements and limitations regarding recover installations.
- 5.6.1 For mechanically attached components over existing roof decks, fasteners shall be tested in the existing deck for withdrawal resistance. A qualified design professional shall review the data for comparison to the minimum requirements for the system. Testing shall be in accordance with [Testing Application Standard TAS 105](#).
- 5.6.2 For bonded insulation or membrane over existing substrates in a re-roof (tear off) or recover installation, the existing deck or existing roof surface shall be examined for compatibility with the adhesive to be installed. If any surface conditions exist that bring system performance into question, field uplift testing in accordance with [Testing Application Standard TAS 124](#) shall be conducted on mock-ups of the proposed new roof assembly.
- 5.6.3 For bonded insulation or membrane over existing substrates in a recover installation, the existing roof system shall be capable of resisting project design pressures on its own merit to the satisfaction of the Authority Having Jurisdiction, as documented through field uplift testing in accordance with [Testing Application Standard TAS 124](#).
- 5.7 Refer to Appendix 1 for system attachment requirements for wind load resistance.
- 5.7.1 "MDP" = Maximum Design Pressure is the result of testing for wind load resistance based on allowable wind loads, and reflects the ultimate passing pressure divided by 2 (the 2 to 1 margin of safety per [Testing Application Standard TAS 114](#) has already been applied). Refer to **FBC HVHZ 1620** and [Roofing Application Standard RAS 128](#) for determination of design wind loads.
- 5.7.2 For mechanically attached components, the maximum design pressure for the selected assembly shall meet or exceed at least the Zone 1 PRIME design pressure determined in accordance with **FBC HVHZ 1620** or [Roofing Application Standard RAS 128](#). Elevated pressure zones shall employ an attachment density designed by a qualified design professional to resist the elevated pressure criteria. Analysis shall be in accordance with [Roofing Application Standard RAS 117](#) or **RAS 137**. ****This extrapolation is not permitted for systems marked with an asterisk*.***
- 5.7.3 For assemblies marked with an asterisk*, the maximum design pressure (MDP) limitation shall be applicable to all roof pressure zones. Rational analysis is not permitted.
- 5.8 All components in the roof assembly shall have quality assurance audit in accordance with **F.A.C. Rule 61G20-3**. Refer to the Product Approval of the component manufacturer for components listed in Appendix 1 that are produced by a Product Manufacturer other than the report holder on [Page 1](#) of this PEER, or are not referenced in [Section 4](#).

6. INSTALLATION:

GAF Liquid Applied Roof Systems shall be installed in accordance with **GAF** current, published installation instructions, subject to the [Limitations of Use](#) noted herein.

7. BUILDING PERMIT REQUIREMENTS:

As required by the Building Official or Authority Having Jurisdiction to properly evaluate the installation of this product.

8. MANUFACTURING PLANTS:

Contact the named QA entity for manufacturing facilities covered by **F.A.C. Rule 61G20-3** QA requirements. Refer to [Section 4](#) herein for products and production locations having met codified material standards.

9. QUALITY ASSURANCE ENTITY:

[UL \(QUA9625\)](#): (360) 817-5512; bsai.inspections@ul.com

- THE 8-PAGES THAT FOLLOW FORM PART OF THIS PEER -

APPENDIX 1: ATTACHMENT REQUIREMENTS FOR WIND UPLIFT RESISTANCE

| TABLE | DECK | APPLICATION | TYPE | DESCRIPTION | PAGE |
|--------------------|---------------------|-----------------------------------|------|--|------|
| 1A | Wood | New, Reroof (Tear-Off) or Recover | B-1 | Mech. Attached Base Insulation, Bonded Top Insulation, Bonded Roof Cover | 5 |
| 1B | Wood | New, Reroof (Tear-Off) or Recover | C-1 | Mechanically Attached Insulation, Liquid Applied Roof System | 6 |
| 2A | Structural concrete | New or Reroof (Tear-Off) | A-1 | Bonded Insulation, Liquid Applied Roof System | 7 |
| 2B | Structural concrete | New or Reroof (Tear-Off) | F | Non-Insulated, Liquid Applied Roof System | 8 |

The following notes apply to the systems outlined herein:

- The roof system evaluation herein pertains to above-deck roof components. Roof decks and structural members shall be in accordance with FBC HVHZ requirements to the satisfaction of the Authority Having Jurisdiction. Deck-attachment details pertain to 'as-tested' conditions under [Testing Application Standard](#) TAS 114, Appendix J.
- Unless otherwise noted, fasteners and stress plates shall be as follows. Fasteners shall be of sufficient length for the following engagements:

| FASTENER/PLATE OPTIONS | | | | |
|------------------------|-----|---|---|---|
| DECK TYPE | BY | PARTS | | MINIMUM ENGAGEMENT |
| | | LOOSE PARTS | PRE-ASSEMBLED PARTS | |
| Wood | GAF | Drill-Tec #12 Fastener, Drill-Tec #12 DP Fastener, Drill-Tec #12 DPH Fastener, Drill-Tec #14 Fastener or Drill-Tec #14 HD Fastener with Drill-Tec 3" Standard Steel Plate, Drill-Tec 3" Steel Plate, Drill-Tec AccuTrac Flat Plate, Drill-Tec AccuTrac Recessed Plate (insulation only), Drill-Tec 3" Flat Steel Plate or Drill-Tec 3" Recessed Steel Plate | Drill-Tec 3" ASAP Flat, Drill-Tec 3" ASAP Recessed, Drill-Tec ASAP 3S or Drill-Tec Heavy Duty ASAP Roofing Fastener Assembled with a 3" Metal Plate | Minimum ¾-inch plywood penetration or minimum 1-inch wood plank embedment |

- Unless otherwise noted, insulation may be any one layer or combination of FBC Approved (Local or Statewide) board(s) that meet FBC HVHZ 1516 and, for foam plastic, FBC Chapter 26, when installed with the roof cover.
- RESERVED
- RESERVED
- Unless otherwise noted, insulation adhesive application rates are as follows.
 - ✓ Ribbon or bead width is at the time of application; the ribbons/beads shall expand as noted in the manufacturer's published instructions.
 - ✓ When multiple layers(s) of insulation and/or coverboard are installed in ribbon-applied adhesive, board joints shall be staggered.
 - ✓ The maximum edge distance from the adhesive ribbon to the edge of the insulation board shall be not less than one-half the specified ribbons spacing.

| INSULATION ADHESIVE REFERENCES | | | | |
|--------------------------------|-------------------------------|------------------|-------------------------------|--|
| BY | ADHESIVE | REFERENCE | FBC HVHZ FILE | MINIMUM RATE |
| GAF | GAF LRF Adhesive M | 'LRF-M' | 23-0802.14 | Continuous 0.75 to 1-inch ribbons, 12-inch o.c. |
| GAF | GAF LRF Adhesive M Canister | 'LRF-M Canister' | N/A | Continuous 1 to 1.5-inch ribbons, 12-inch o.c. |
| GAF | GAF LRF Adhesive XF | 'LRF-XF' | N/A | Continuous 0.75 to 1-inch ribbons, 12-inch o.c. |
| OMG, Inc. | OlyBond 500 Adhesive Fastener | 'OB500' | 24-0422.18 | Continuous 0.75-inch wide ribbons, 12-inch o.c. (PaceCart, SpotShot or Canister) |

- 7 Unless otherwise noted, all insulations are flat-stock or taper board of the minimum thickness noted. Tapered polyisocyanurate at the following thickness limitations may be substituted with the following Maximum Design Pressure (MDP) limitations. In no case shall these values be used to 'increase' the MDP listings in the tables; rather if MDP listing below meets or exceeds that listed for a particular system in the tables, then the thinner board listed below may be used as a drop-in for the equivalent thicker material listed in the table.

| MDP LIMITATIONS FOR TAPERED POLYISOCYANURATE INSULATIONS | | | | |
|--|--|---|-----------------------------|-----------|
| ADHESIVE | INSULATION | | MIN. TAPERED THICKNESS (IN) | MDP (PSF) |
| | LISTED PRODUCT | FBC FILE OR NOA | | |
| LRF-M | EnergyGuard Polyiso Insulation, EnergyGuard Ultra Polyiso Insulation | 24-0227.08 | 0.5 | -232.5 |
| LRF-XF | EnergyGuard Polyiso Insulation, EnergyGuard Ultra Polyiso Insulation | 24-0227.08 | 0.5 | -292.5 |
| LRF-XF | EnergyGuard RA | 24-0402.09 | 0.5 | -487.5 |
| OB500 | EnergyGuard Polyiso Insulation, EnergyGuard Ultra Polyiso Insulation | 24-0227.08 | 0.5 | -292.5 |
| OB500 | EnergyGuard RH | 19-1017.09 | 0.5 | -315.0 |
| OB500 | EnergyGuard RA | 24-0402.09 | 0.5 | -487.5 |
| Hot asphalt | Any EnergyGuard polyisocyanurate listed with adhesive herein | Various | 0.5 | -240.0 |

- 8 Bonded polyisocyanurate insulation boards shall be maximum 4 x 4 ft.
- 9 For mechanically attached components, the maximum design pressure for the selected assembly shall meet or exceed at least the Zone 1 PRIME design pressure determined in accordance with [FBC HVHZ 1620](#) or [Roofing Application Standard](#) RAS 128. Elevated pressure zones shall employ an attachment density designed by a qualified design professional to resist the elevated pressure criteria in accordance with [Roofing Application Standard](#) RAS 117 or RAS 137. *This extrapolation is not permitted for systems marked with an asterisk*
- 10 For assemblies marked with an asterisk*, the maximum design pressure for the selected assembly shall meet or exceed critical design pressure determined in accordance with FBC Chapter 16. No rational analysis is permitted for these systems.
- 11 For mechanically attached components over existing decks, fasteners shall be tested in the existing deck for withdrawal resistance in accordance with [Testing Application Standard](#) TAS 105. A qualified design professional shall review the data for comparison to the minimum requirements for the system. Should the fastener resistance be less than that required, a revised fastener spacing – prepared, signed and sealed by a qualified design professional in accordance with [Roofing Application Standard](#) RAS 117 or RAS 137 – may be submitted to the Building Official for review and acceptance.
- 12 RESERVED
- 13 RESERVED
- 14 RESERVED
- 15 For bonded membrane applications, unless otherwise noted, refer to the following.

| MEMBRANE / ADHESIVE COMBINATIONS | | | |
|--|------------------|---|-------------|
| ROOF COVERS | | | |
| REFERENCE | LAYER | MATERIAL | APPLICATION |
| GAF Premium Acrylic HydroStop: | Joint Treatment: | Top Insulation Layer if no Base Ply is installed: GAF Premium Acrylic HydroStop Base Coat is brush applied over all top-layer insulation joints at 6-inch width at a rate of 1.25 gal./square, centered about each joint. 6-inch wide GAF Premium Fabric is embedded in the wet GAF Premium Acrylic HydroStop Base Coat. The fabric is then saturated with additional GAF Premium Acrylic HydroStop Base Coat brush applied at 1.25 gal./square. | |
| GAF Premium Acrylic HydroStop System: | LARS: | GAF Premium Acrylic HydroStop Base Coat is brush applied at a minimum rate of 1.25 gal./square. GAF Premium Fabric is embedded in the wet GAF Premium Acrylic HydroStop Base Coat with 4 in. wide seams and is saturated with additional GAF Premium Acrylic HydroStop Base Coat brush applied at a minimum rate of 1.25 gal./square. Two (2) or more coats of GAF Premium Acrylic HydroStop Top Coat are applied at a minimum rate of 0.75 gal./square per coat. | |
| | Surfacing: | (Optional) GAF TrafficCoat Pedestrian Surface Coating (Smooth or Textured) applied per GAF published installation instructions. | |
| GAF Surface Seal SB Thermoplastic Rubber Coating | LARS: | Two (2) coats at 1.5 gal./square per coat. Consult GAF for allowable cure-time between coats. | |

| MEMBRANE / ADHESIVE COMBINATIONS VAPOR BARRIERS | | |
|--|--|---|
| REFERENCE | MATERIAL | APPLICATION |
| VB-APP-TA (smooth) | Ruberoid Torch Smooth | Torch-applied |
| VB-APP-TA (granule) | Ruberoid Torch Granule | Torch-applied |
| VB-BP1-AA | One or more GAFGLAS #75 Base Sheet, Tri-Ply #75 Base Sheet, GAFGLAS #80 Ultima Base Sheet | Hot asphalt at 25 lbs/square. |
| VB-BP2-AA | One or two plies, GAFGLAS Ply 4, GAFGLAS Ply 4 M, Tri-Ply Ply 4 Ply Sheet, GAFGLAS FlexPly 6 or GAFGLAS FlexPly 6 M | Hot asphalt at 25 lbs/square. |
| VB-SBS-AA | Ruberoid 20 Smooth, Ruberoid Mop Smooth, Ruberoid Mop Smooth 1.5, Ruberoid Mop Plus Smooth, Ruberoid 30 Granule or Ruberoid Mop Granule, Ruberoid Mop Plus Granule | Hot asphalt at 25 lbs/square. |
| VB-SBS-CA | Ruberoid 20 Smooth, Ruberoid Mop Smooth, Ruberoid Mop Smooth 1.5, Ruberoid Mop Plus Smooth, Ruberoid 30 Granule or Ruberoid Mop Granule, Ruberoid Mop Plus Granule | Matrix 102 SBS Membrane Adhesive at 1.5 gal/sq. |
| VB-SBS-SA | Liberty SBS Self-Adhering Cap Sheet | Self-adhering |
| VB-SBS-TA | Ruberoid HW 20 Smooth, Ruberoid HW 25 Smooth, Ruberoid HW 30 Smooth, Ruberoid HW Smooth, Ruberoid HW Granule or Ruberoid HW Plus Granule | Torch-applied |

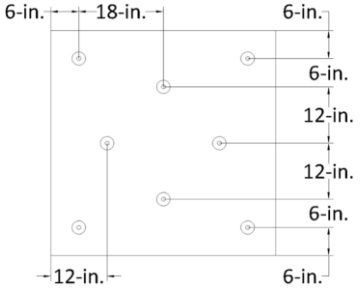
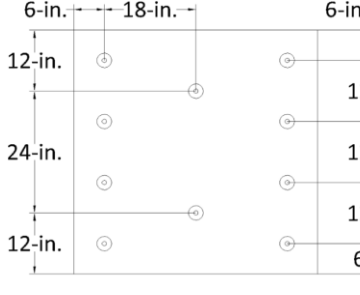
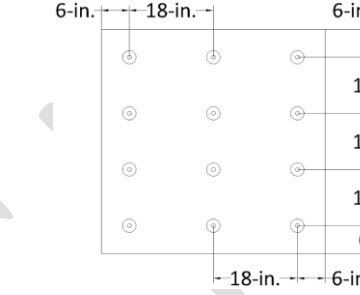
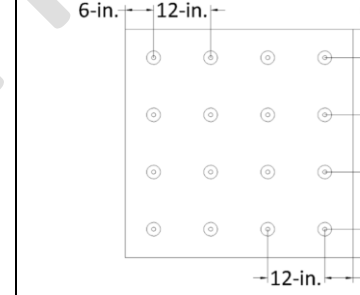
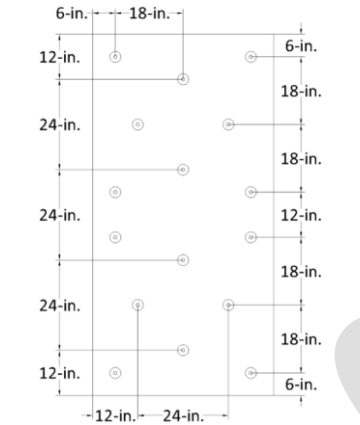
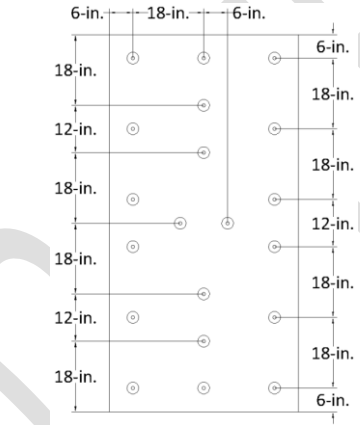

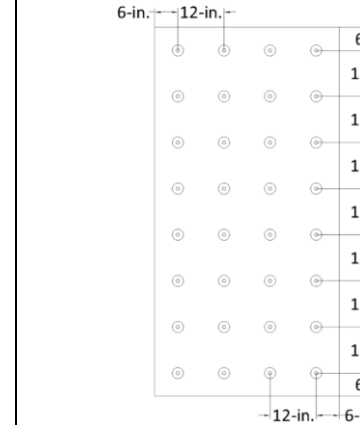
16 **Thermal Barrier and/or Vapor Barrier Options:**

16A **Structural Concrete Decks:** The lesser of the MDP listings below vs. that for the selected assembly applies.

| STRUCTURAL CONCRETE DECK: VAPOR BARRIER FOLLOWED BY ADHERED INSULATION | | | | | |
|--|--|---|--|--|---------------------------|
| OPTION # | PRIMER | VAPOR BARRIER (Note 15) | | INSULATION ADHESIVE PER TABLE 2A | MDP (psf) |
| | | TYPE | APPLICATION | | |
| C-VB-1. | Matrix 307 Premium Asphalt Primer or ASTM D41 primer | VB-APP-TA (granule) | Torch-applied | Hot asphalt | -225.0 |
| C-VB-2. | Matrix 307 Premium Asphalt Primer or ASTM D41 primer | VB-BP-AA1 | Hot asphalt applied | Hot asphalt | -360.0 |
| C-VB-3. | Matrix 307 Premium Asphalt Primer or ASTM D41 primer | VB-BP2-AA or VB-SBS-AA | Hot asphalt applied | Hot asphalt | -495.0 |
| C-VB-4. | None | GAF SA Vapor Retarder XL | Self-adhering | LRF-M, 12-inch o.c. | -180.0 |
| C-VB-5. | Matrix 307 Premium Asphalt Primer or ASTM D41 primer | VB-APP-TA (granule), VB-SBS-AA, VB-SBS-CA, VB-SBS-SA or VB-SBS-TA | See Note 15 | LRF-M, 12-inch o.c. | -180.0 |
| C-VB-6. | GAF SA Primer | GAF SA Vapor Retarder | Self-adhering | LRF-M, 12-inch o.c. | -202.5 |
| C-VB-7. | Matrix 307 Premium Asphalt Primer or ASTM D41 primer | VB-BP1-AA, VB-BP2-AA or VB-SBS-AA | Hot asphalt applied | LRF-M, 12-inch o.c. | -495.0 |
| C-VB-8. | Matrix 307 Premium Asphalt Primer or ASTM D41 primer | VB-APP-TA (granule) | Torch-applied | LRF-XF, 12-inch o.c. | -169.0 |
| C-VB-9. | None | GAF SA Vapor Retarder XL | Self-adhering | LRF-XF 12-inch o.c. | -180.0 |
| C-VB-10. | Matrix 307 Premium Asphalt Primer or ASTM D41 primer | VB-APP-TA (granule), VB-SBS-AA, VB-SBS-CA, VB-SBS-SA or VB-SBS-TA | See Note 15 | LRF-XF, 12-inch o.c. | -180.0 |
| C-VB-11. | GAF SA Primer | GAF SA Vapor Retarder | Self-adhering | LRF-XF, 12-inch o.c. | -202.5 |
| C-VB-12. | Matrix 307 Premium Asphalt Primer or ASTM D41 primer | VB-SBS-SA | Self-adhering | LRF-XF, 12-inch o.c. | -250.0 |
| C-VB-13. | Matrix 307 Premium Asphalt Primer or ASTM D41 primer | VB-BP1-AA, VB-BP2-AA or VB-SBS-AA | Hot asphalt applied | LRF-XF, 12-inch o.c. | -262.5 |
| C-VB-14. | Matrix 307 Premium Asphalt Primer or ASTM D41 primer | Ruberoid 30 | Hot asphalt applied | LRF-XF, 12-inch o.c. | -270.0 |
| C-VB-15. | Matrix 307 Premium Asphalt Primer or ASTM D41 primer | VB-APP-TA (smooth) | Torch-applied | OB500, 12-inch o.c. | -165.0 |
| C-VB-16. | None | GAF SA Vapor Retarder XL | Self-adhering | OlyBond 500, 12-inch o.c. | -180.0 |
| C-VB-17. | Matrix 307 Premium Asphalt Primer or ASTM D41 primer | VB-SBS-AA, VB-SBS-CA, VB-SBS-SA or VB-SBS-TA | See Note 15 | OB500, 12-inch o.c. | -180.0 |
| C-VB-18. | Matrix 307 Premium Asphalt Primer or ASTM D41 primer | VB-SBS-SA | Self-adhering | OB500, 12-inch o.c. | -187.5 |
| C-VB-19. | Matrix 307 Premium Asphalt Primer or ASTM D41 primer | Ruberoid 20 Smooth | Matrix 102 SBS Membrane Adhesive at 1.5 gal/square | OB500, 12-inch o.c. | -202.5 |
| C-VB-20. | GAF SA Primer | GAF SA Vapor Retarder | Self-adhering | OB500, 12-inch o.c. | -202.5 |
| C-VB-21. | Matrix 307 Premium Asphalt Primer or ASTM D41 primer | VB-APP-TA (granule) | Torch-applied | OB500, 12-inch o.c. | -225.0 |
| C-VB-22. | Matrix 307 Premium Asphalt Primer or ASTM D41 primer | Ruberoid HW Smooth | Torch-applied | OB500, 12-inch o.c. | -232.5 |

| STRUCTURAL CONCRETE DECK: VAPOR BARRIER FOLLOWED BY ADHERED INSULATION | | | | | |
|--|--|---|---------------------|--|------------------------------|
| OPTION # | PRIMER | VAPOR BARRIER (Note 15) | | INSULATION ADHESIVE PER TABLE 2A | MDP (PSF) |
| | | TYPE | APPLICATION | | |
| C-VB-23. | Matrix 307 Premium Asphalt Primer or ASTM D41 primer | VB-BP1-AA, VB-BP2-AA or VB-SBS-AA | Hot asphalt applied | OB500, 12-inch o.c. | -352.5 |

17 Unless otherwise noted, insulation or coverboard attachment patterns for Type B-1 systems are as outlined below.

| INSULATION ATTACHMENT PATTERNS – 4x4 FT BOARDS | | | |
|---|---|---|---|
|  <p>1 per 2.0 ft² (8 per board)</p> |  <p>1 per 1.6 ft² (10 per board)</p> |  <p>1 per 1.3 ft² (12 per board)</p> |  <p>1 per 1.0 ft² (16 per board)</p> |
| INSULATION ATTACHMENT PATTERNS – 4x8 FT BOARDS | | | |
|  <p>1 per 2.0 ft² (16 per board)</p> |  <p>1 per 1.6 ft² (20 per board)</p> |  <p>1 per 1.3 ft² (24 per board)</p> |  <p>1 per 1.0 ft² (32 per board)</p> |

18 “MDP” = Maximum Design Pressure is the result of testing for wind load resistance based on allowable wind loads. Refer to FBC (HVHZ) 1620 and [Roofing Application Standard](#) RAS 128 for determination of design wind loads. [\(Notes 9 and 10\)](#)

TABLE 1A: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, LIQUID APPLIED ROOF SYSTEM

| System No. | Deck (Note 1) | Base Insulation Layer | | | Top Insulation Layer | | Roof Cover (Note 15) | | MDP (psf) |
|---|---|---|---|---------------------------------------|---|---|--|--------------------------------------|--------------------------------|
| | | Type | Fasteners (Note 2 , Note 11) | Attach (Note 17) | Type | Attach (Notes 6,7,8) | Joint Treatment | LARS | |
| GAF PREMIUM ACRYLIC HYDROSTOP SYSTEM: | | | | | | | | | |
| W-1. | Min. 19/32-inch plywood or 1-inch wood plank; 2 ft span; 8d ring shank nails 6" o.c. | Min 2-inch EnergyGuard Polyiso Insulation, EnergyGuard RH | Note 2 (#14 Fastener only) | 1 per 2.0 ft² | Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board | LRF-M, LRF-XF or OB500 | GAF Premium Acrylic HydroStop Insulation Joint Treatment | GAF Premium Acrylic HydroStop System | -52.5 |
| W-2. | Min. 19/32-inch plywood or 1-inch wood plank; 2 ft span; blocked 4 ft o.c.; 8d ring shank nails 6" o.c. | Min. 1.5-inch EnergyGuard Polyiso Insulation | Note 2 (#14 Fastener only) | 1 per 1.6 ft² | Min. 0.25-inch DensDeck Prime | LRF-M, LRF-XF or OB500 | GAF Premium Acrylic HydroStop Insulation Joint Treatment | GAF Premium Acrylic HydroStop System | -60.0 |
| W-3. | Min. 19/32-inch plywood or 1-inch wood plank; 2 ft span; blocked 4 ft o.c.; 8d ring shank nails 6" o.c. | Min. 1-inch EnergyGuard Polyiso Insulation | Note 2 (#14 Fastener only) | 1 per 1.3 ft² | Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board | LRF-M, LRF-XF or OB500 | GAF Premium Acrylic HydroStop Insulation Joint Treatment | GAF Premium Acrylic HydroStop System | -82.5 |
| W-4. | Min. 19/32-inch plywood or 1-inch wood plank; 2 ft span; blocked 4 ft o.c.; 8d ring shank nails 3" o.c. | Min. 3-inch EnergyGuard Polyiso Insulation | Note 2 (#14 Fastener only) | 1 per 1.0 ft² | Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board | LRF-M, LRF-XF or OB500, 6-inch o.c. | GAF Premium Acrylic HydroStop Insulation Joint Treatment | GAF Premium Acrylic HydroStop System | -135.0 |
| GAF SURFACE SEAL SB THERMOPLASTIC RUBBER COATING: | | | | | | | | | |
| W-5. | Min. 19/32-inch plywood or 1-inch wood plank; 2 ft span; 8d ring shank nails 6" o.c. | Min 2-inch EnergyGuard Polyiso Insulation, EnergyGuard RH | Note 2 (#14 Fastener only) | 1 per 2.0 ft² | Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board | LRF-M, LRF-XF or OB500 | GAF Surface Seal SB Thermoplastic Rubber Coating | | -52.5 |
| W-6. | Min. 19/32-inch plywood or 1-inch wood plank; 2 ft span; blocked 4 ft o.c.; 8d ring shank nails 6" o.c. | Min. 1.5-inch EnergyGuard Polyiso Insulation | Note 2 (#14 Fastener only) | 1 per 1.6 ft² | Min. 0.25-inch DensDeck Prime | LRF-M, LRF-XF or OB500 | GAF Surface Seal SB Thermoplastic Rubber Coating | | -60.0 |
| W-7. | Min. 19/32-inch plywood or 1-inch wood plank; 2 ft span; blocked 4 ft o.c.; 8d ring shank nails 6" o.c. | Min. 1-inch EnergyGuard Polyiso Insulation | Note 2 (#14 Fastener only) | 1 per 1.3 ft² | Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board | LRF-M, LRF-XF or OB500 | GAF Surface Seal SB Thermoplastic Rubber Coating | | -82.5 |
| W-8. | Min. 19/32-inch plywood or 1-inch wood plank; 2 ft span; blocked 4 ft o.c.; 8d ring shank nails 3" o.c. | Min. 3-inch EnergyGuard Polyiso Insulation | Note 2 (#14 Fastener only) | 1 per 1.0 ft² | Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board | LRF-M, LRF-XF or OB500, 6-inch o.c. | GAF Surface Seal SB Thermoplastic Rubber Coating | | -135.0 |

TABLE 1B: WOOD DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, LIQUID APPLIED ROOF SYSTEM

| System No. | Deck (Note 1) | Base Insulation and/or Thermal Barrier Layer(s) (Note 13) | Top Insulation Layer | | | Roof Cover (Note 15) | | MDP (psf) |
|---|--|---|-------------------------------|--|---------------------------------------|--|--------------------------------------|--------------|
| | | | Type | Fasteners (Note 2 , Note 11) | Attach (Note 17) | Joint Treatment | LARS | |
| GAF PREMIUM ACRYLIC HYDROSTOP SYSTEM: | | | | | | | | |
| W-9. | Min. 19/32-inch plywood; 2 ft span; 8d ring shank nails, 6" o.c. | (Optional) One or more layers, any combination, loose laid | Min. 0.25-inch DensDeck | Drill-Tec #12 or #14 Fastener with Drill-Tec 3" Standard Steel Plate | 1 per 1.3 ft² | GAF Premium Acrylic HydroStop Insulation Joint Treatment | GAF Premium Acrylic HydroStop System | -60.0 |
| W-10. | Min. 15/32-inch plywood; 2 ft span; 8d ring shank nails, 6" o.c. | (Optional) One or more layers, any combination, loose laid | Min. 0.25-inch DensDeck Prime | Drill-Tec #12 or #14 Fastener with Drill-Tec 3" Standard Steel Plate | 1 per 1.3 ft² | GAF Premium Acrylic HydroStop Insulation Joint Treatment | GAF Premium Acrylic HydroStop System | -67.5 |
| GAF SURFACE SEAL SB THERMOPLASTIC RUBBER COATING: | | | | | | | | |
| W-11. | Min. 15/32-inch plywood; 2 ft span; 8d ring shank nails, 6" o.c. | (Optional) One or more layers, any combination, loose laid | Min. 0.25-inch DensDeck Prime | Drill-Tec #12 or #14 Fastener with Drill-Tec 3" Standard Steel Plate | 1 per 1.3 ft² | GAF Surface Seal SB Thermoplastic Rubber Coating | | -67.5 |

**TABLE 2A: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, LIQUID APPLIED ROOF SYSTEM**

REFER TO [TABLE 1A](#) FOR VAPOR BARRIER OPTIONS

| System No. | Deck (Note 1) | Base Insulation Layer | | Top Insulation Layer | | Roof Cover (Note 15) | | MDP (psf)* |
|---|---------------------|---|-------------------------|---|-------------------------|--|--------------------------------------|---------------|
| | | Type | Attach (Notes 6,7,8) | Type | Attach (Notes 6,7,8) | Joint/Lap Treatment | LARS | |
| GAF PREMIUM ACRYLIC HYDROSTOP SYSTEM: | | | | | | | | |
| C-1 | Structural concrete | Min. 1-inch EnergyGuard Polyiso Insulation | LRF-M | Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board | LRF-M | GAF Premium Acrylic HydroStop Insulation Joint Treatment | GAF Premium Acrylic HydroStop System | -247.5 |
| C-2 | Structural concrete | Min. 1-inch EnergyGuard Polyiso Insulation | LRF-M | Min. 0.25-inch DensDeck Prime | LRF-M | GAF Premium Acrylic HydroStop Insulation Joint Treatment | GAF Premium Acrylic HydroStop System | -270.0 |
| C-3 | Structural concrete | Min. 1-inch EnergyGuard Polyiso Insulation | LRF-M, 6-inch o.c. | Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board | LRF-M, 6-inch o.c. | GAF Premium Acrylic HydroStop Insulation Joint Treatment | GAF Premium Acrylic HydroStop System | -510.0 |
| C-4 | Structural concrete | Min. 1.5-inch EnergyGuard Polyiso Insulation | LRF-M Canister | (Optional) Additional layer(s) base insulation | LRF-M Canister | GAF Premium Acrylic HydroStop Insulation Joint Treatment | GAF Premium Acrylic HydroStop System | -222.5 |
| C-5 | Structural concrete | (Optional) Min. 1.5-inch EnergyGuard Polyiso Insulation | LRF-M Canister | Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board | LRF-M Canister | GAF Premium Acrylic HydroStop Insulation Joint Treatment | GAF Premium Acrylic HydroStop System | -247.5 |
| C-6 | Structural concrete | Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board | LRF-M Canister | None | N/A | GAF Premium Acrylic HydroStop Insulation Joint Treatment | GAF Premium Acrylic HydroStop System | -375.0 |
| C-7 | Structural concrete | Min. 1-inch EnergyGuard Polyiso Insulation | LRF-XF | Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board | LRF-XF | GAF Premium Acrylic HydroStop Insulation Joint Treatment | GAF Premium Acrylic HydroStop System | -247.5 |
| C-8 | Structural concrete | Min. 1-inch EnergyGuard Polyiso Insulation | LRF-XF | Min. 0.25-inch DensDeck Prime | LRF-XF | GAF Premium Acrylic HydroStop Insulation Joint Treatment | GAF Premium Acrylic HydroStop System | -270.0 |
| C-9 | Structural concrete | Min. 1-inch EnergyGuard Polyiso Insulation | LRF-XF, 6-inch o.c. | Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board | LRF-XF, 6-inch o.c. | GAF Premium Acrylic HydroStop Insulation Joint Treatment | GAF Premium Acrylic HydroStop System | -510.0 |
| C-10 | Structural concrete | Min. 0.5-inch EnergyGuard Polyiso Insulation | OB500 | Min. 0.25-inch DensDeck or DensDeck Prime | OB500 | GAF Premium Acrylic HydroStop Insulation Joint Treatment | GAF Premium Acrylic HydroStop System | -135.0 |
| C-11 | Structural concrete | Min. 1-inch EnergyGuard Polyiso Insulation | OB500 | Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board | OB500 | GAF Premium Acrylic HydroStop Insulation Joint Treatment | GAF Premium Acrylic HydroStop System | -247.5 |
| C-12 | Structural concrete | Min. 1-inch EnergyGuard Polyiso Insulation | OB500 | Min. 0.25-inch DensDeck Prime | OB500 | GAF Premium Acrylic HydroStop Insulation Joint Treatment | GAF Premium Acrylic HydroStop System | -270.0 |
| C-13 | Structural concrete | Min. 1-inch EnergyGuard Polyiso Insulation | OB500, 6-inch o.c. | Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board | OB500, 6-inch o.c. | GAF Premium Acrylic HydroStop Insulation Joint Treatment | GAF Premium Acrylic HydroStop System | -510.0 |
| GAF SURFACE SEAL SB THERMOPLASTIC RUBBER COATING: | | | | | | | | |
| C-14 | Structural concrete | Min. 1-inch EnergyGuard Polyiso Insulation | LRF-M | Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board | LRF-M | GAF Surface Seal SB Thermoplastic Rubber Coating | | -247.5 |
| C-15 | Structural concrete | Min. 1-inch EnergyGuard Polyiso Insulation | LRF-M | Min. 0.25-inch DensDeck Prime | LRF-M | GAF Surface Seal SB Thermoplastic Rubber Coating | | -270.0 |
| C-16 | Structural concrete | Min. 1-inch EnergyGuard Polyiso Insulation | LRF-M, 6-inch o.c. | Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board | LRF-M, 6-inch o.c. | GAF Surface Seal SB Thermoplastic Rubber Coating | | -510.0 |
| C-17 | Structural concrete | (Optional) Min. 1.5-inch EnergyGuard Polyiso Insulation | LRF-M Canister | Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board | LRF-M Canister | GAF Surface Seal SB Thermoplastic Rubber Coating | | -247.5 |

**TABLE 2A: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, LIQUID APPLIED ROOF SYSTEM**

REFER TO [TABLE 1A](#) FOR VAPOR BARRIER OPTIONS

| System No. | Deck (Note 1) | Base Insulation Layer | | Top Insulation Layer | | Roof Cover (Note 15) | | MDP (psf)* |
|------------|-------------------------------|---|--------------------------------------|---|--------------------------------------|--|------|----------------------------|
| | | Type | Attach (Notes 6,7,8) | Type | Attach (Notes 6,7,8) | Joint/Lap Treatment | LARS | |
| C-18 | Structural concrete | Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board | LRF-M Canister | None | N/A | GAF Surface Seal SB Thermoplastic Rubber Coating | | -375.0 |
| C-19 | Structural concrete | Min. 1-inch EnergyGuard Polyiso Insulation | LRF-XF | Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board | LRF-XF | GAF Surface Seal SB Thermoplastic Rubber Coating | | -247.5 |
| C-20 | Structural concrete | Min. 1-inch EnergyGuard Polyiso Insulation | LRF-XF | Min. 0.25-inch DensDeck Prime | LRF-XF | GAF Surface Seal SB Thermoplastic Rubber Coating | | -270.0 |
| C-21 | Structural concrete | Min. 1-inch EnergyGuard Polyiso Insulation | LRF-XF, 6-inch o.c. | Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board | LRF-XF, 6-inch o.c. | GAF Surface Seal SB Thermoplastic Rubber Coating | | -510.0 |
| C-22 | Structural concrete | Min. 0.5-inch EnergyGuard Polyiso Insulation | OB500 | Min. 0.25-inch DensDeck Prime | OB500 | GAF Surface Seal SB Thermoplastic Rubber Coating | | -135.0 |
| C-23 | Structural concrete | Min. 1-inch EnergyGuard Polyiso Insulation | OB500 | Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board | OB500 | GAF Surface Seal SB Thermoplastic Rubber Coating | | -247.5 |
| C-24 | Structural concrete | Min. 1-inch EnergyGuard Polyiso Insulation | OB500 | Min. 0.25-inch DensDeck Prime | OB500 | GAF Surface Seal SB Thermoplastic Rubber Coating | | -270.0 |
| C-25 | Structural concrete | Min. 1-inch EnergyGuard Polyiso Insulation | OB500, 6-inch o.c. | Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board | OB500, 6-inch o.c. | GAF Surface Seal SB Thermoplastic Rubber Coating | | -510.0 |

**TABLE 2B: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE F: NON-INSULATED, LIQUID APPLIED ROOF SYSTEM**

| System No. | Deck (Note 1) | Primer | Roof Cover (Note 15) | | MDP (psf)* |
|------------|-------------------------------|---|--------------------------------------|--|----------------------------|
| | | | Base Ply | LARS | |
| C-26 | Structural concrete | GAF Bonding Primer or GAF Multi-Purpose Primer | None | GAF Premium Acrylic HydroStop System | -502.5 |
| C-27 | Structural concrete | (Optional) GAF Bonding Primer or GAF Multi-Purpose Primer | None | GAF Surface Seal SB Thermoplastic Rubber Coating | -1237.5 |