

FLORIDA DEPARTMENT OF
Business & Professional Regulation



[DBPR HOME](#) | [ABOUT DBPR](#) | [DBPR DIVISIONS](#) | [CONTACT DBPR](#)

[BCIS Home](#) | [Log In](#) | [User Registration](#) | [Hot Topics](#) | [Submit Surcharge](#) | [Stats & Facts](#) | [Publications](#) | [Contact Us](#) | [BCIS Site Map](#) | [Links](#) | [Search](#)



Product Approval
USER: Public User

[Product Approval Menu](#) > [Product or Application Search](#) > [Application List](#) > **Application Detail**

OFFICE OF THE
SECRETARY

FL #	FL14822-R8						
Application Type	Revision						
Code Version	2023						
Application Status	Approved						
Comments							
Archived	<input type="checkbox"/>						
Product Manufacturer	GAF						
Address/Phone/Email	1 Campus Drive Parisppany, NJ 07054 (800) 766-3411 mstieh@gaf.com						
Authorized Signature	Michael Stieh michael.stieh@gaf.com						
Technical Representative	William Broussard						
Address/Phone/Email	1 Campus Drive Parsippany, NJ 07054 (800) 766-3411 TechnicalQuestionsGAF@gaf.com						
Quality Assurance Representative							
Address/Phone/Email							
Category	Panel Walls						
Subcategory	Siding						
Compliance Method	Evaluation Report from a Florida Registered Architect or a Licensed Florida Professional Engineer <input type="checkbox"/> Evaluation Report - Hardcopy Received						
Florida Engineer or Architect Name who developed the Evaluation Report	Robert Nieminen						
Florida License	PE-59166						
Quality Assurance Entity	UL LLC						
Quality Assurance Contract Expiration Date	07/12/2025						
Validated By	John W. Knezevich, PE <input checked="" type="checkbox"/> Validation Checklist - Hardcopy Received						
Certificate of Independence	FL14822_R8_COI_2023_07_COI_NIEMINEN.pdf						
Referenced Standard and Year (of Standard)	<table> <thead> <tr> <th>Standard</th><th>Year</th></tr> </thead> <tbody> <tr> <td>ASTM C1186</td><td>2016</td></tr> <tr> <td>ASTM E330</td><td>2014</td></tr> </tbody> </table>	Standard	Year	ASTM C1186	2016	ASTM E330	2014
Standard	Year						
ASTM C1186	2016						
ASTM E330	2014						
Equivalence of Product Standards Certified By							
Sections from the Code							

Product Approval Method

Method 1 Option D

Date Submitted 10/12/2023
 Date Validated 10/18/2023
 Date Pending FBC Approval 10/21/2023
 Date Approved 12/12/2023

Summary of Products

FL #	Model, Number or Name	Description
14822.1	WeatherSide™ Fiber-Cement Shingles (NON-HVHZ)	Fiber-cement shingles for use in FBC non-HVHZ jurisdictions.
Limits of Use Approved for use in HVHZ: No Approved for use outside HVHZ: Yes Impact Resistant: N/A Design Pressure: +N/A/-66.3 Other: 1.) The design pressure noted in this application pertains to one particular application of the shingles. Refer to ER Appendix for all applications and max. design pressures. 2.) Refer to ER Section 5 for Limits of Use.		Installation Instructions FL14822 R8 II 2023 10 12 FINAL A1 PEER-GAF-012.A WEATHERSIDE FL14822-R8.pdf Verified By: Robert Nieminen PE-59166 Created by Independent Third Party: Yes Evaluation Reports FL14822 R8 AE 2023 10 12 FINAL PEER-GAF-012.A WEATHERSIDE FL14822-R8.pdf Created by Independent Third Party: Yes

[Back](#)[Next](#)

[Contact Us](#) :: [2601 Blair Stone Road, Tallahassee FL 32399](#) Phone: 850-487-1824

The State of Florida is an AA/EEO employer. [Copyright 2007-2013 State of Florida](#). :: [Privacy Statement](#) :: [Accessibility Statement](#) :: [Refund Statement](#)

Under Florida law, email addresses are public records. If you do not want your e-mail address released in response to a public-records request, do not send electronic mail to this entity. Instead, contact the office by phone or by traditional mail. If you have any questions, please contact 850.487.1395. *Pursuant to Section 455.275(1), Florida Statutes, effective October 1, 2012, licensees licensed under Chapter 455, F.S. must provide the Department with an email address if they have one. The emails provided may be used for official communication with the licensee. However email addresses are public record. If you do not wish to supply a personal address, please provide the Department with an email address which can be made available to the public. To determine if you are a licensee under Chapter 455, F.S., please click [here](#).

Product Approval Accepts:



NEMO | etc.

Certificate of Authorization #32455
353 Christian Street, Unit #13
Oxford, CT 06478
(203) 262-9245

ENGINEER

EVALUATE

TEST

CONSULT

P.E. EVALUATION REPORT (PEER)

GAF

1 Campus Drive
Parsippany, NJ 07054
(800) 766-3411

PEER-GAF-012.A.R8

FL14822-R8 (NON-HVHZ)

Date of Issuance: 08/26/2011

Revision 8: 10/12/2023

SCOPE:

This P.E. Evaluation Report (henceforth 'PEER') is issued under **F.A.C. Rule 61G20-3** and the applicable rules and regulations governing the use of construction materials in the State of Florida. The documentation submitted has been reviewed by Robert Nieminen, P.E. for use of the product under the Florida Building Code. The product described herein has been evaluated for compliance with the **8th Edition (2023) Florida Building Code** [sections noted herein](#).

DESCRIPTION: WeatherSide™ Fiber-Cement Shingles (NON-HVHZ)

LABELING: Labeling shall be in accordance with the requirements of the Accredited Quality Assurance Agency noted herein and the minimum provisions of **FBC 1404.10**.

CONTINUED COMPLIANCE: This PEER is valid until such time as the named product(s) changes, the referenced Quality Assurance or production facility location(s) changes, or Code provisions that relate to the product(s) change. Acceptance of our PEERs by the named client constitutes agreement to notify NEMO ETC, LLC of any changes to the product(s), the Quality Assurance, or the production facility location(s). NEMO ETC, LLC requires a complete review of its PEER relative to updated Code requirements with each Code Cycle.

ADVERTISEMENT: The Florida Product Approval Number (FL#) preceded by the words "Nemo P.E. Evaluated" may be displayed in advertising literature. If any portion of the PEER is displayed, then it shall be done in its entirety.

INSPECTION: Upon request, a copy of this entire PEER shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This PEER consists of pages 1 through 3, plus a 6-page Appendix.


Prepared by:

Digitally signed by
Robert Nieminen
Date: 2023.10.12
'15:53:29 -04'00

This item has been digitally signed and sealed by Robert Nieminen, P.E.

Printed copies of this document are not considered signed and sealed, and the signature must be verified on any electronic copies.

Robert Nieminen, Florida P.E. 59166, FBC ANE1983
NEMO ETC, LLC, Florida CA #32455

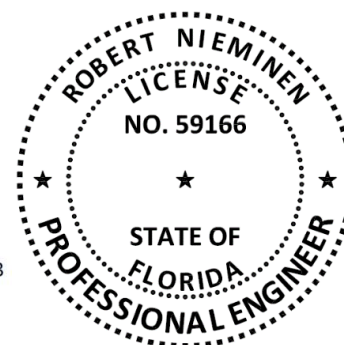

CERTIFICATION OF INDEPENDENCE:

1. NEMO ETC, LLC does not have, nor does it intend to acquire or will it acquire, a financial interest in any company manufacturing or distributing products it evaluates.
2. NEMO ETC, LLC is not owned, operated or controlled by any company manufacturing or distributing products it evaluates.
3. Robert Nieminen, P.E. does not have nor will acquire, a financial interest in any company manufacturing or distributing products for which the PEERs are being issued.
4. Robert Nieminen, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.
5. This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this PEER, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.

©2019 NEMO ETC, LLC

PANEL WALLS - SIDING EVALUATION:

1. SCOPE:

Product Category: Panel Walls

Sub-Category: Siding

Compliance Statement: WeatherSide™ Fiber-Cement Shingles, as produced by GAF, have demonstrated compliance with the following sections of the **8th Edition (2023) Florida Building Code** through testing in accordance with the following Standards. Compliance is subject to the [Installation Requirements](#) and [Limitations of Use](#) set forth herein.

2. STANDARDS:

SECTION	PROPERTY	STANDARD
1404.10	Material standard	ASTM C1186
1609.1	Wind resistance	ASTM E330

3. REFERENCES:

ENTITY	EXAMINATION	REFERENCE	DATE
ERD (TST6049)	ASTM C1186	G30200.01.10	01/08/2010
FET (TST1654)	Transverse Load (Wind)	T135-11	02/18/2011
FET (TST1654)	Transverse Load (Wind)	T169-11	04/05/2011
FET (TST1654)	Transverse Load (Wind)	T180-11	04/22/2011
FET (TST1654)	Transverse Load (Wind)	T186-11	04/29/2011
NEMO (TST6049)	ASTM C1186	4v-GAF-22-SSFBR-01	10/10/2023
UL, LLC. (TST)	ASTM E136, UL723	Year-Equivalence Declaration	06/30/2023
UL, LLC. (QUA9625)	Quality Control	Service Confirmation	07/12/2022
UL, LLC. (QUA9625)	Quality Control	Florida BCIS	current

4. PRODUCT DESCRIPTION:

This PEER covers **WeatherSide™ Fiber-Cement Shingles**, and is limited to the specific product trade names referenced in this report subject to the [Installation Requirements](#) and [Limitations of Use](#) herein.

TABLE 1: EVALUATED SIDING PRODUCTS

PRODUCT	MATERIAL STANDARD	THICKNESS (IN)	DIMENSIONS (IN)	SURFACE/EDGES
WeatherSide™ Emphasis™ Shingles	ASTM C1186, Type A, Grade 1	9/32	14-5/8 x 25-5/32	wood-grain surface and thatched edge
WeatherSide™ Profile Shingles	ASTM C1186, Type A, Grade 1	11/64	9 x 32 12 x 24 14-5/8 x 32	striated surface and straight edge
WeatherSide™ Purity™ Shingles	ASTM C1186, Type A, Grade 1	11/64	12 x 24	textured surface and Straight, Thatched or Wavy edge

5. LIMITATIONS:

- 5.1 This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this PEER, or previous versions thereof, is/was used for permitting or design guidance. PEERs are not to be construed as representing any attributes not specifically listed, nor are PEERs to be construed as an endorsement of the subject, or a recommendation for its use. There is no warranty by NEMO ETC, LLC or Robert Nieminen, P.E., express or implied, as to any finding or other matter in this PEER, or as to any product covered by the PEER.
- 5.2 This PEER is not for use in FBC High Velocity Hurricane Zone jurisdictions, as defined in FBC Chapter 2 (Broward and Miami-Dade Counties).
- 5.3 This PEER does not address fire-resistance-rating performance of the completed wall assemblies.

5.4 Wind Resistance (Transverse Load):

Limitations relating to design wind pressure resistance are outlined in Appendix 1.

“MDP” = Maximum Design Pressure is the result of testing for wind load resistance based on allowable wind loads. Refer to **FBC 1609** for determination of project-specific design wind pressures. The MDP for the selected installation shall meet or exceed the design wind pressure requirement for the project for each pressure zone.

5.5 WeatherSide™ Fiber-Cement Shingles are not intended for racking or shear resistance.

5.6 For existing substrates, the Authority Having Jurisdiction may require fasteners be tested in the existing substrate for withdrawal resistance. A qualified design professional shall review the data for comparison to the minimum requirements for the system.

5.7 All products in the wall assembly shall have quality assurance audit in accordance with F.A.C. [Rule 61G20-3](#).

6. INSTALLATION:

6.1 **WeatherSide™ Fiber-Cement Shingles** shall be installed in accordance with **GAF** published installation instructions, subject to the [Limitations of Use](#) noted herein.

6.2 All **WeatherSide™ Fiber-Cement Shingles** products shall be installed using white, 12 ga. x 1¾-inch long, hot-dip galvanized, ring-shank nails. Nails are supplied by **GAF** as an accessory product.

6.3 The underlying wall substrate shall include a water-resistive barrier in accordance with **FBC 1403.2**.

6.4 Minimum system attachment requirements set forth in Appendix 1 shall not be exceeded.

7. BUILDING PERMIT REQUIREMENTS:

As required by the Building Official or Authority Having Jurisdiction to properly evaluate the installation of this product.

8. MANUFACTURING PLANTS:

Wind Gap, PA

9. QUALITY ASSURANCE ENTITY:

[UL \(QUA9625\)](#): (360) 817-5512; bsai.inspections@ul.com

- THE SIX (6)-PAGES THAT FOLLOW FORM PART OF THIS PEER -

The following notes apply to the systems outlined herein:

1. The evaluation herein pertains to wall-cladding components. Framing and sheathing shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction.
2. Fasteners shall be corrosion resistant. Fastener lengths noted are minimum lengths, and shall be adjusted as necessary for minimum 1-inch embedment into wood studs (Reference: FBC 1405.16).
3. "MDP" = Maximum Design Pressure is the result of testing for wind load resistance based on allowable wind loads. Refer to FBC 1609 for determination of design wind loads. The MDP for the selected installation shall meet or exceed the design wind pressure requirement for the project for each pressure zone.

TABLE 1: SYSTEM DESCRIPTION & ALLOWABLE DESIGN PRESSURES						
WEATHERSIDE™						
System No.	Framing (Note 1)	Sheathing (Note 1)	Siding	Attachment		MDP (psf)
				Fasteners	Spacing / Placement	
1.	Min. nominal 2x4 #2 SPF at max. 16-inch o.c.	Min. 19/32" plywood	Profile 9, Profile 12 or Purity™	Min. 12 ga. x min. 1.75-inch long ring shank nails	Min. three (3) nails per shingle, per Figure 1A, 1B, 1C, 1D or 1E.	-41.6

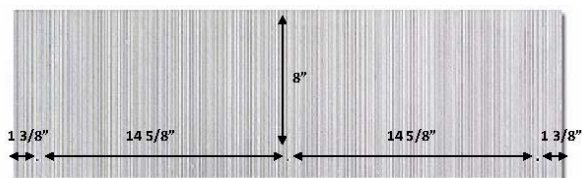


Figure 1A: Profile 9, 3-nails/shingle

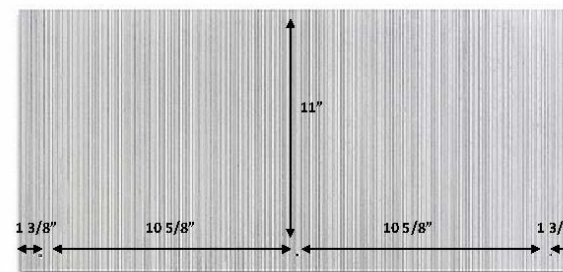


Figure 1B: Profile 12, 3-nails/shingle

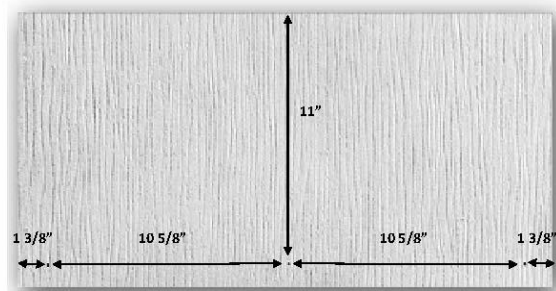


Figure 1C: Purity™ Straight, 3-nails/shingle

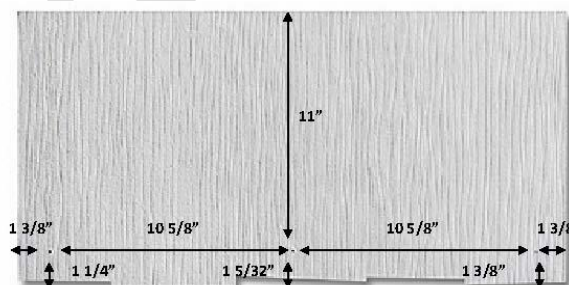


Figure 1D: Purity™ Thatched, 3-nails/shingle

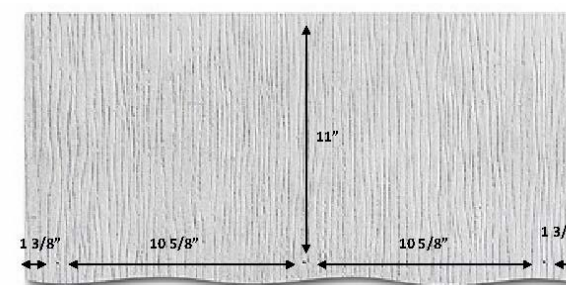


Figure 1E: Purity™ Wavy, 3-nails/shingle

TABLE 2: SYSTEM DESCRIPTION & ALLOWABLE DESIGN PRESSURES
WEATHERSIDE™

System No.	Framing (Note 1)	Sheathing (Note 1)	Siding	Attachment		MDP (psf)
				Fasteners	Spacing / Placement	
2.	Min. nominal 2x4 #2 SPF at max. 16-inch o.c.	Min. 19/32" plywood	Profile 9, Profile 12 or Purity™	Min. 12 ga. x min. 1.75-inch long ring shank nails	Min. five (5) nails per shingle, per Figure 2A, 2B, 2C, 2D or 2E.	-66.3

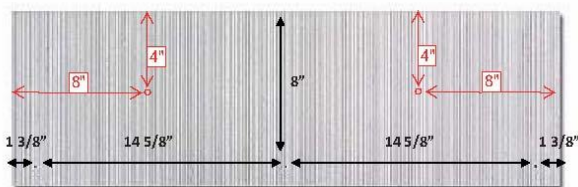


Figure 2A: Profile 9, 5-nails/shingle

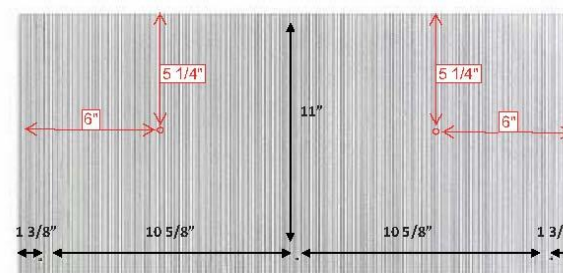


Figure 2B: Profile 12, 5-nails/shingle

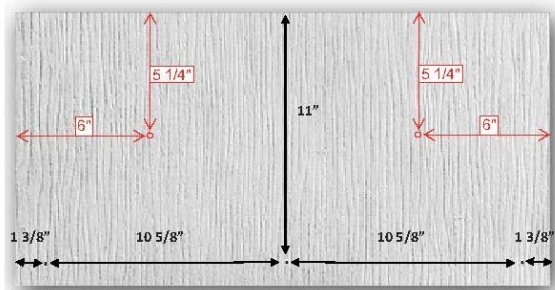


Figure 2C: Purity™ Straight, 5-nails/shingle

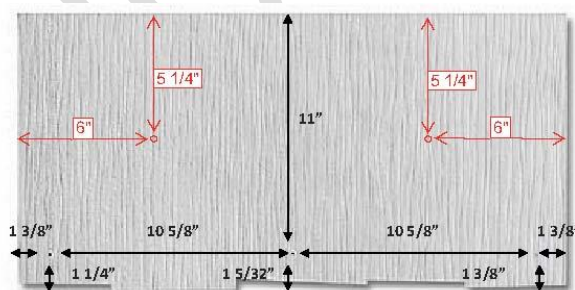


Figure 2D: Purity™ Thatched, 5-nails/shingle

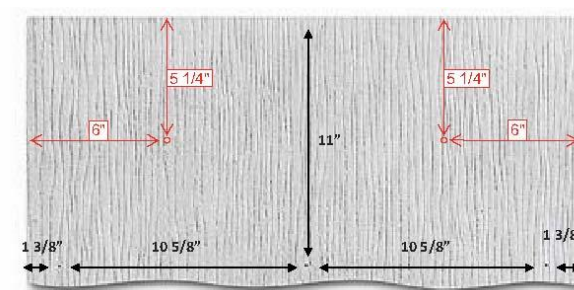


Figure 2E: Purity™ Wavy, 5-nails/shingle

TABLE 3: SYSTEM DESCRIPTION & ALLOWABLE DESIGN PRESSURES
WEATHERSIDE™

System No.	Framing (Note 1)	Sheathing (Note 1)	Siding	Attachment		MDP (psf)
				Fasteners	Spacing / Placement	
3.	Min. nominal 2x4 #2 SPF at max. 16-inch o.c.	Min. 19/32" plywood	Profile 14	Min. 12 ga. x min. 1.75-inch long ring shank nails	Min. three (3) nails per shingle per Figure 3.	-25.6

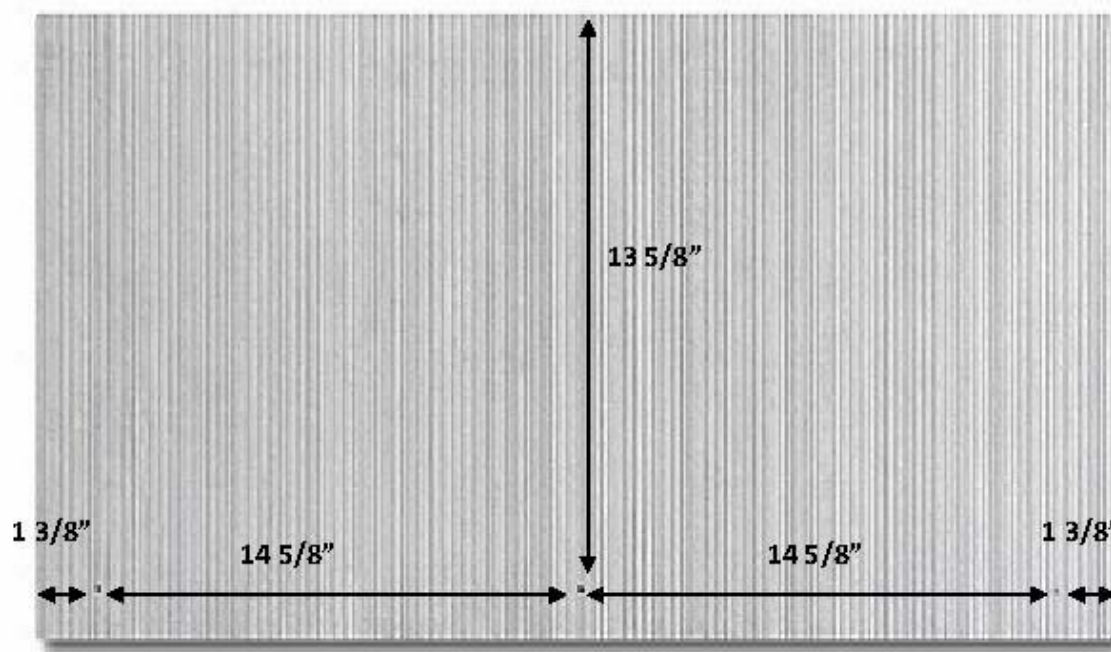


Figure 3: Profile 14, 3-nails/shingle

TABLE 4: SYSTEM DESCRIPTION & ALLOWABLE DESIGN PRESSURES
WEATHERSIDE™

System No.	Framing (Note 1)	Sheathing (Note 1)	Siding	Attachment		MDP (psf)
				Fasteners	Spacing / Placement	
4.	Min. nominal 2x4 #2 SPF at max. 16-inch o.c.	Min. 19/32" plywood	Profile 14	Min. 12 ga. x min. 1.75-inch long ring shank nails	Min. five (5) nails per shingle per Figure 4.	-42.7

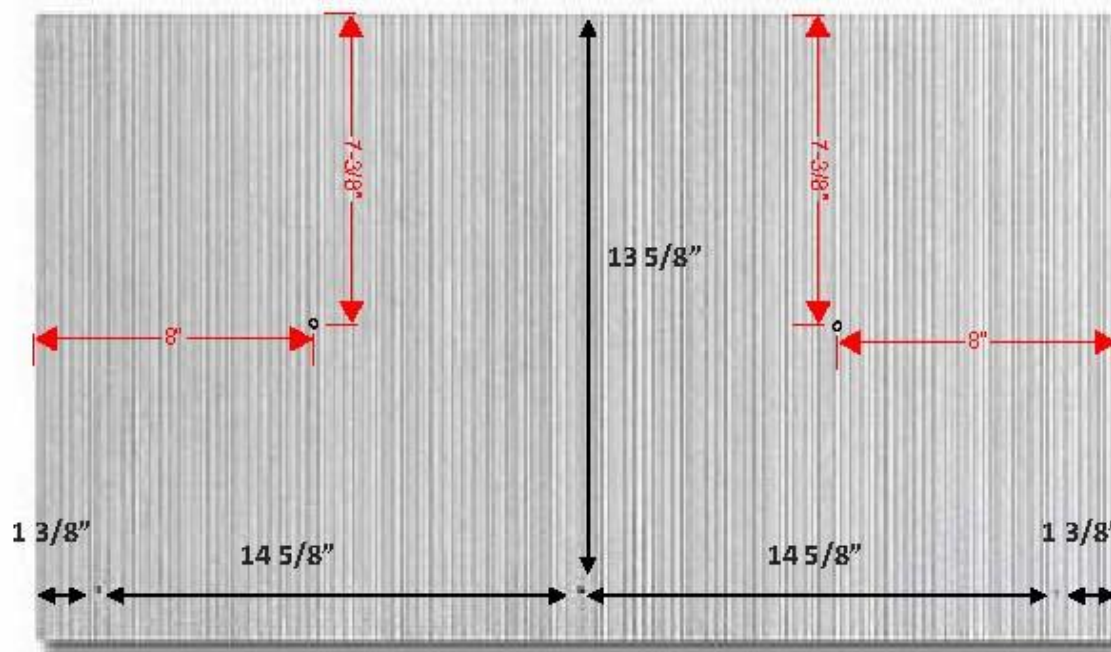


Figure 4: Profile 14, 5-nails/shingle

TABLE 5: SYSTEM DESCRIPTION & ALLOWABLE DESIGN PRESSURES
WEATHERSIDE™

System No.	Framing (Note 1)	Sheathing (Note 1)	Siding	Attachment		MDP (psf)
				Fasteners	Spacing / Placement	
5.	Min. nominal 2x4 #2 SPF at max. 16-inch o.c.	Min. 19/32" plywood	Emphasis™	Min. 12 ga. x min. 1.75-inch long ring shank nails	Min. three (3) nails per shingle per Figure 5.	-32.6

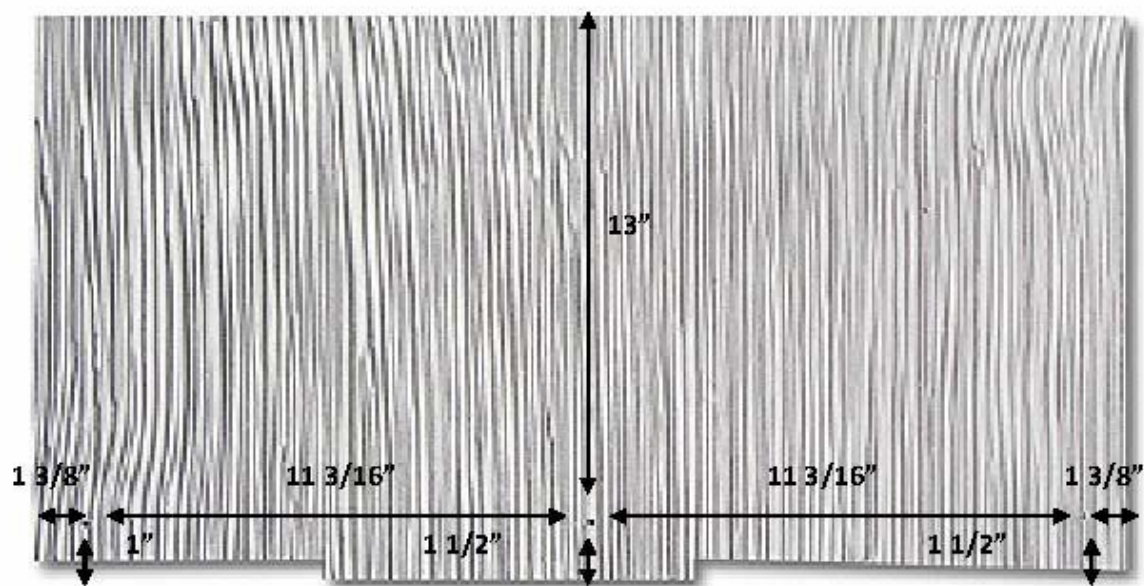


Figure 5: Emphasis™, 3-nails/shingle

TABLE 6: SYSTEM DESCRIPTION & ALLOWABLE DESIGN PRESSURES
WEATHERSIDE™

System No.	Framing (Note 1)	Sheathing (Note 1)	Siding	Attachment		MDP (psf)
				Fasteners	Spacing / Placement	
6.	Min. nominal 2x4 #2 SPF at max. 16-inch o.c.	Min. 19/32" plywood	Emphasis™	Min. 12 ga. x min. 1.75-inch long ring shank nails	Min. five (5) nails per shingle per Figure 6.	-54.3

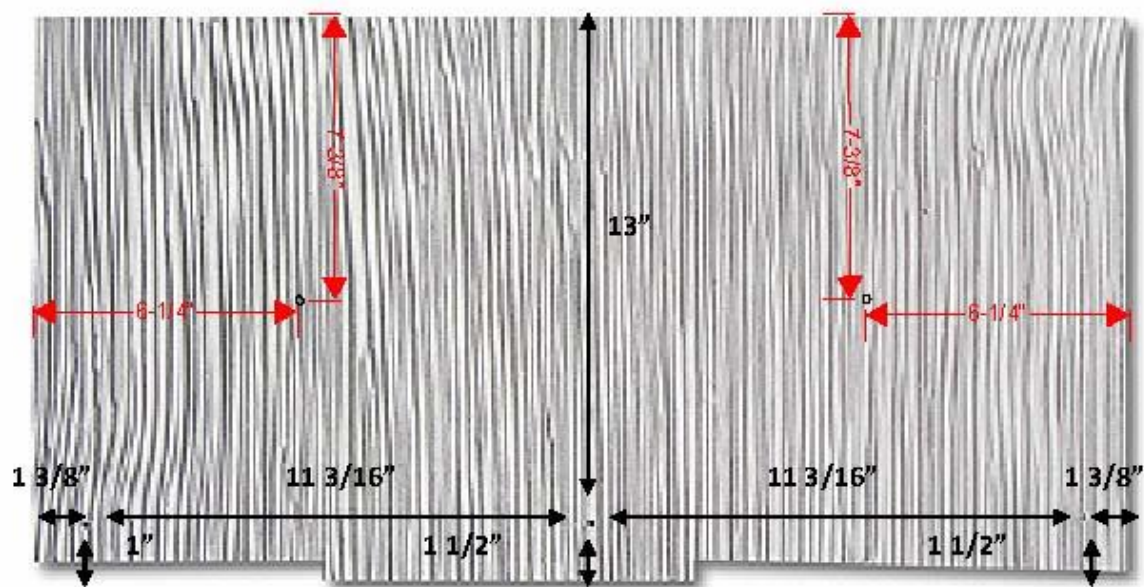


Figure 6: Emphasis™, 5-nails/shingle