


**15-YEAR MAX
GUARANTEE**

TPO ONLY

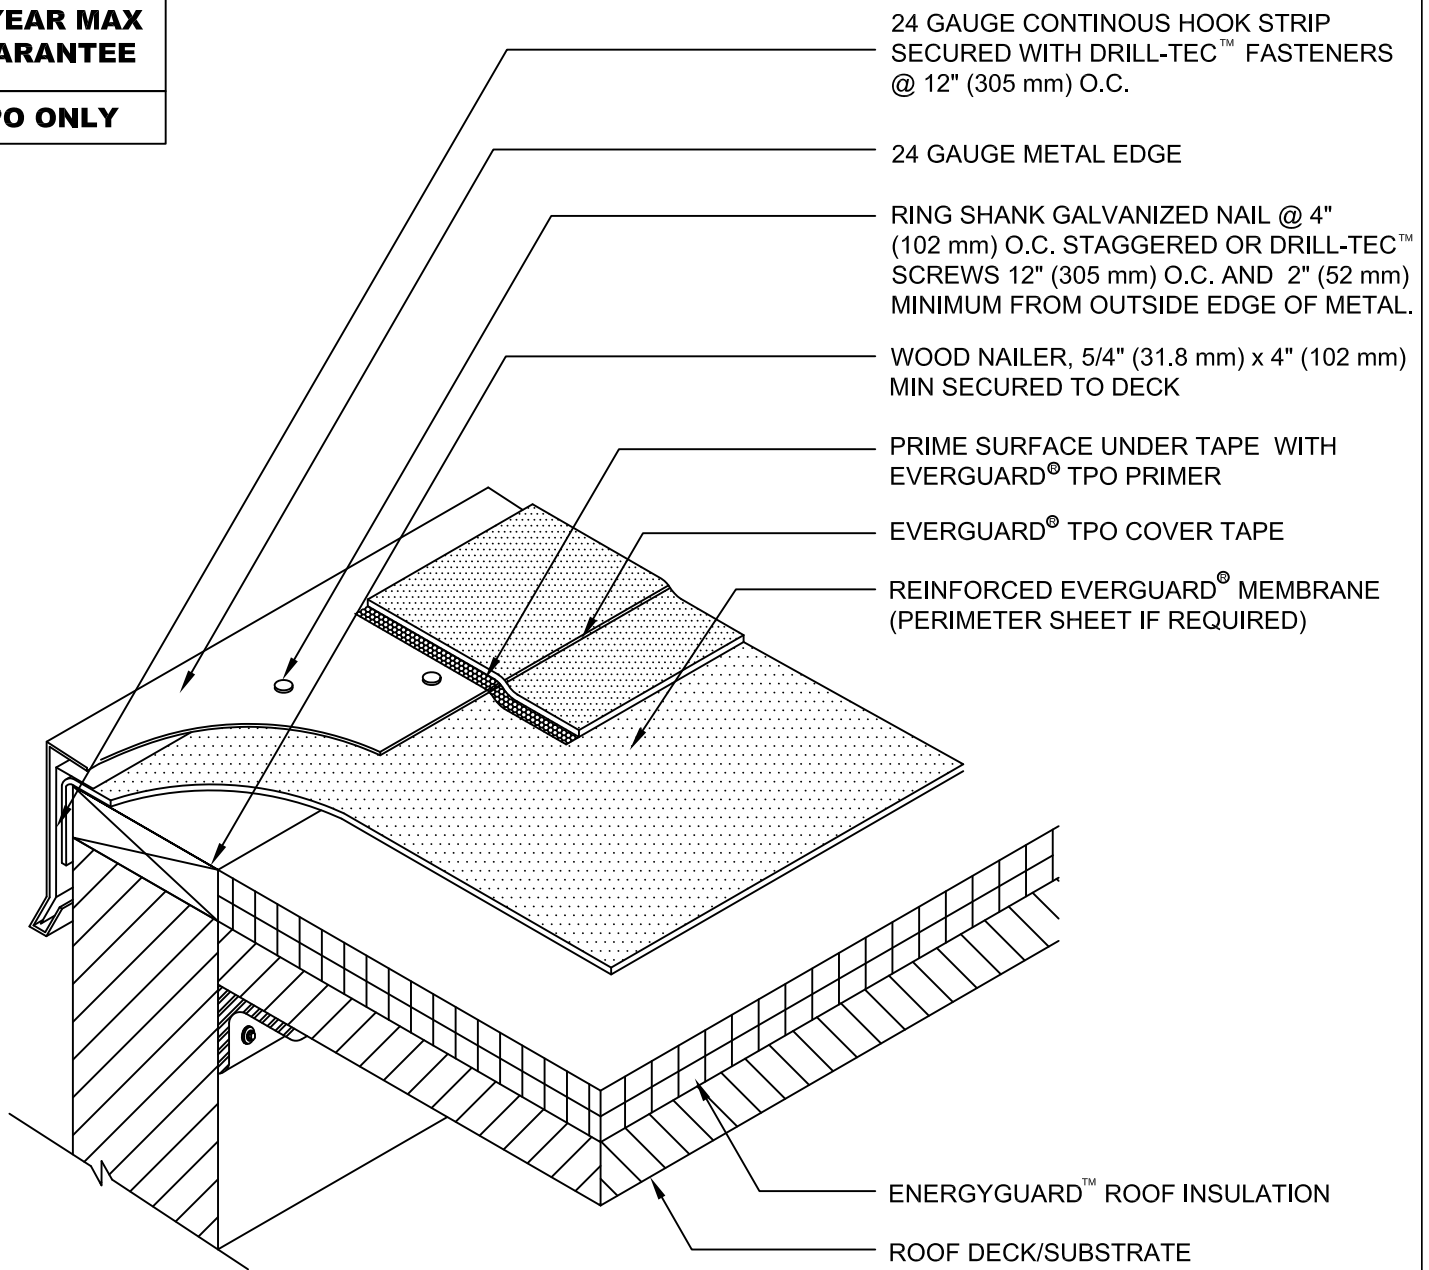

24 GAUGE CONTINUOUS HOOK STRIP
SECURED WITH DRILL-TEC™ FASTENERS
@ 12" (305 mm) O.C.

24 GAUGE METAL EDGE

RING SHANK GALVANIZED NAIL @ 4"
(102 mm) O.C. STAGGERED OR DRILL-TEC™
SCREWS 12" (305 mm) O.C. AND 2" (52 mm)
MINIMUM FROM OUTSIDE EDGE OF METAL.

WOOD NAILER, 5/4" (31.8 mm) x 4" (102 mm)
MIN SECURED TO DECK

PRIME SURFACE UNDER TAPE WITH
EVERGUARD® TPO PRIMER

EVERGUARD® TPO COVER TAPE

REINFORCED EVERGUARD® MEMBRANE
(PERIMETER SHEET IF REQUIRED)

ENERGYGUARD™ ROOF INSULATION

ROOF DECK/SUBSTRATE

NOTE:

1. FOR INSULATION THICKNESS GREATER THAN 8" (203 mm), A HARD BOARD IS REQUIRED ON MECHANICAL SYSTEMS ONLY.
2. CLEAN METAL AND MEMBRANE WITH EVERGUARD® TPO SEAM CLEANER AND ALLOW TO DRY. ONCE DRY, PRIME METAL AND MEMBRANE WITH EVERGUARD® TPO PRIMER BEFORE INSTALLING EVERGUARD® TPO COVER TAPE.
3. THIS DETAIL IS **NOT** TO BE USED ON SLOPES GREATER THAN 1:12. FOR SLOPES GREATER THAN 1:12, REFER TO EVERGUARD DETAIL 218 OR 219 .
4. APPLY EVERGUARD® TPO CUT EDGE SEALANT TO ALL CUT REINFORCED TPO EDGES (REFER TO EVERGUARD® DETAIL 115).



EverGuard
SINGLE-PLY ROOFING SYSTEMS
ROOF EDGE SERIES

DRAWING #

213A

COVER TAPE AT ROOF EDGE DETAIL

THIS DETAIL APPLIES TO:
Adhered Systems
Mechanically Attached Systems
Self-Adhered Systems

www.gaf.com
1 Campus Drive,
Parsippany, NJ 07054

SCALE
N.T.S.

REVISION DATE
8-28-17