


**20 YEAR MAX
GUARANTEE**

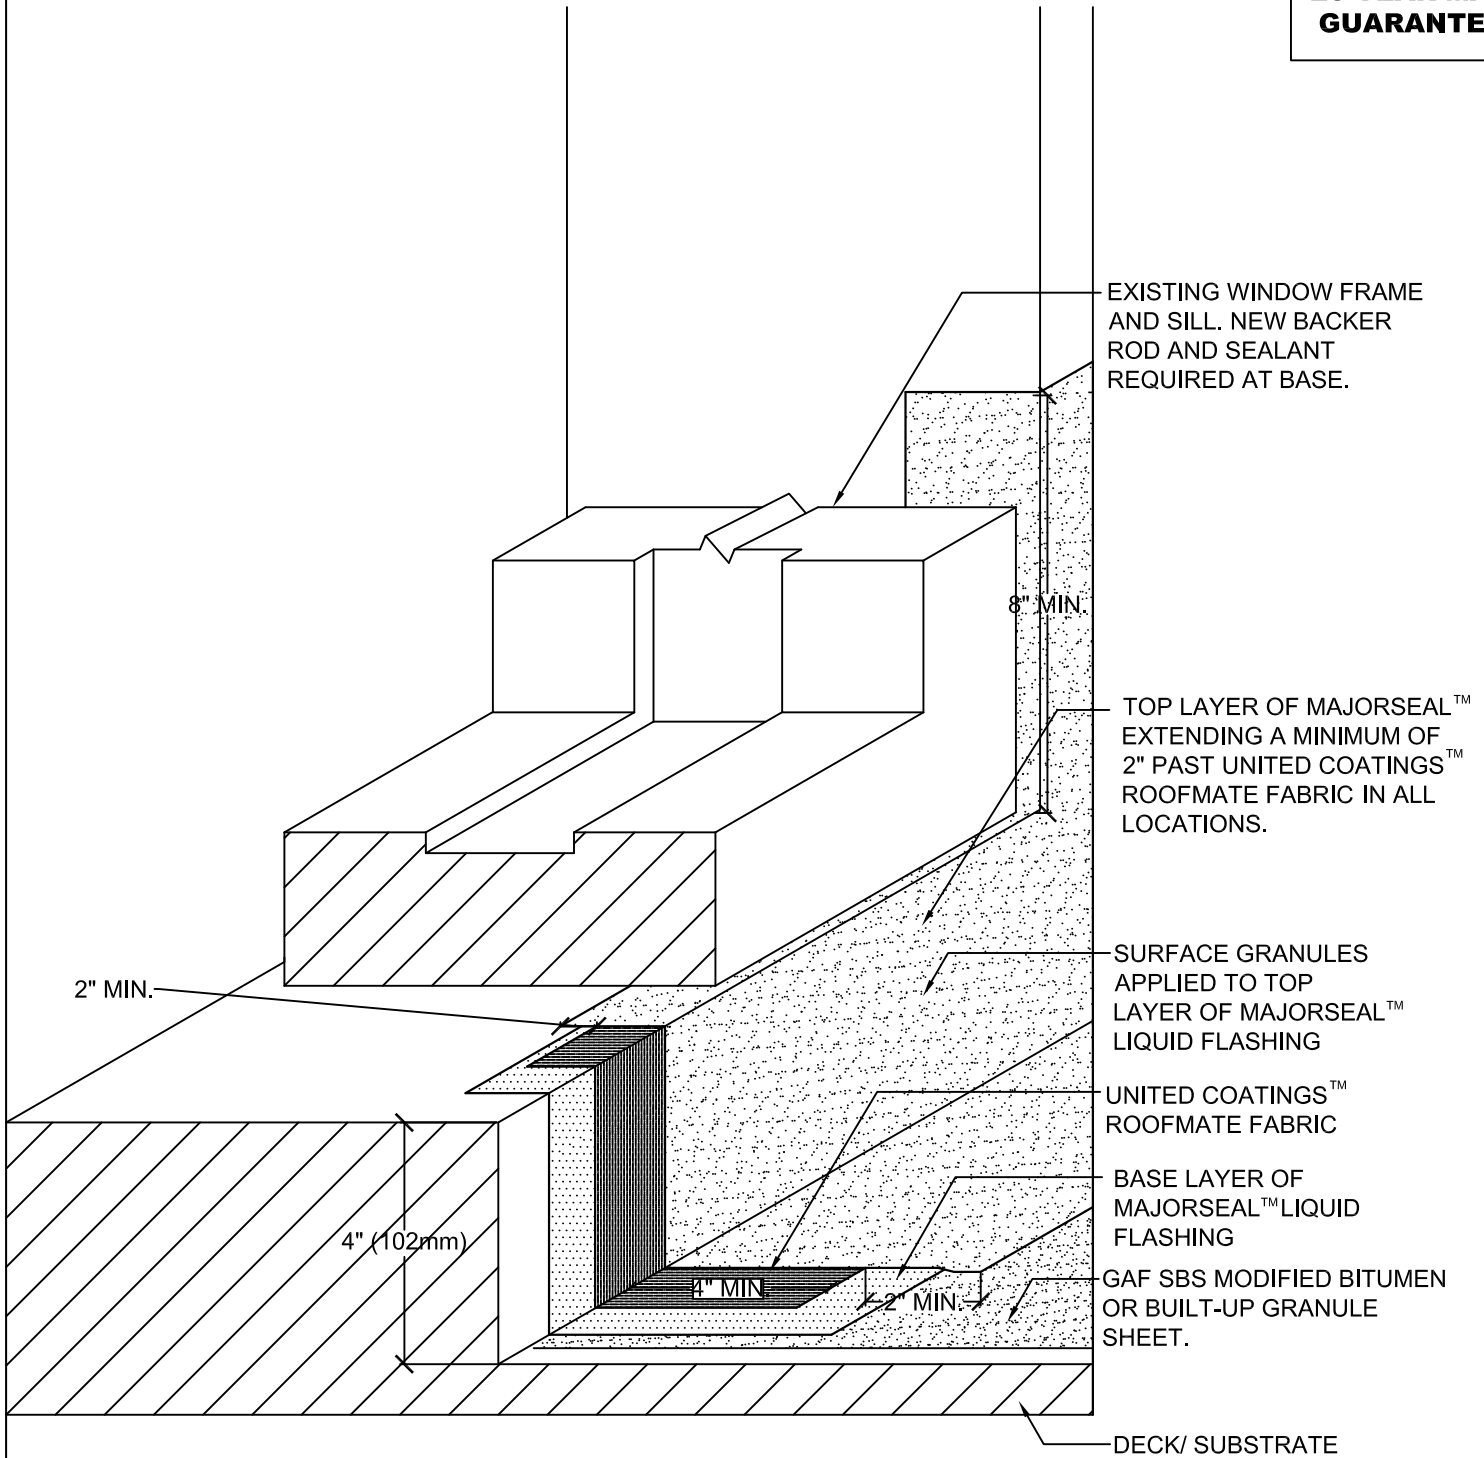

EXISTING WINDOW FRAME AND SILL. NEW BACKER ROD AND SEALANT REQUIRED AT BASE.

TOP LAYER OF MAJORSEAL™ EXTENDING A MINIMUM OF 2" PAST UNITED COATINGS™ ROOFMATE FABRIC IN ALL LOCATIONS.

SURFACE GRANULES APPLIED TO TOP LAYER OF MAJORSEAL™ LIQUID FLASHING

UNITED COATINGS™ ROOFMATE FABRIC


BASE LAYER OF MAJORSEAL™ LIQUID FLASHING

GAF SBS MODIFIED BITUMEN OR BUILT-UP GRANULE SHEET.

DECK/ SUBSTRATE

NOTE:

1. IF GAF GRANULE MEMBRANE IS LEFT EXPOSED OVERNIGHT BEFORE INSTALLING MAJORSEAL LIQUID FLASHING, A TEMPORARY NIGHT SEAL MUST BE INSTALLED. THE NIGHT SEAL MUST BE COMPLETELY REMOVED BEFORE INSTALLING THE FLASHING.

 <small>www.gaf.com 1 Campus Drive, Parsippany, NJ 07054</small>	MAJORSEAL™ LIQUID FLASHING	WINDOW SILL FLASHING	DRAWING # 307	SYSTEM MM
	WALL & CURB SERIES		SCALE N.T.S.	ISSUE/ REVISION DATE 1-1-16