


SINGLE-PLY: TPO & PVC



NOTE:

- 1. REFER TO THE EVERGUARD® DESIGN & APPLICATION GUIDELINES FOR DETAILED INSTALLATION REQUIREMENTS.
- 2. INSULATION BOARDS INSTALLED IN SINGLE OR MULTIPLE LAYERS MUST HAVE THE JOINTS BETWEEN THE BOARDS STAGGERED IN ALL DIRECTIONS A MINIMUM OF 6" (152 mm) BETWEEN LAYERS.

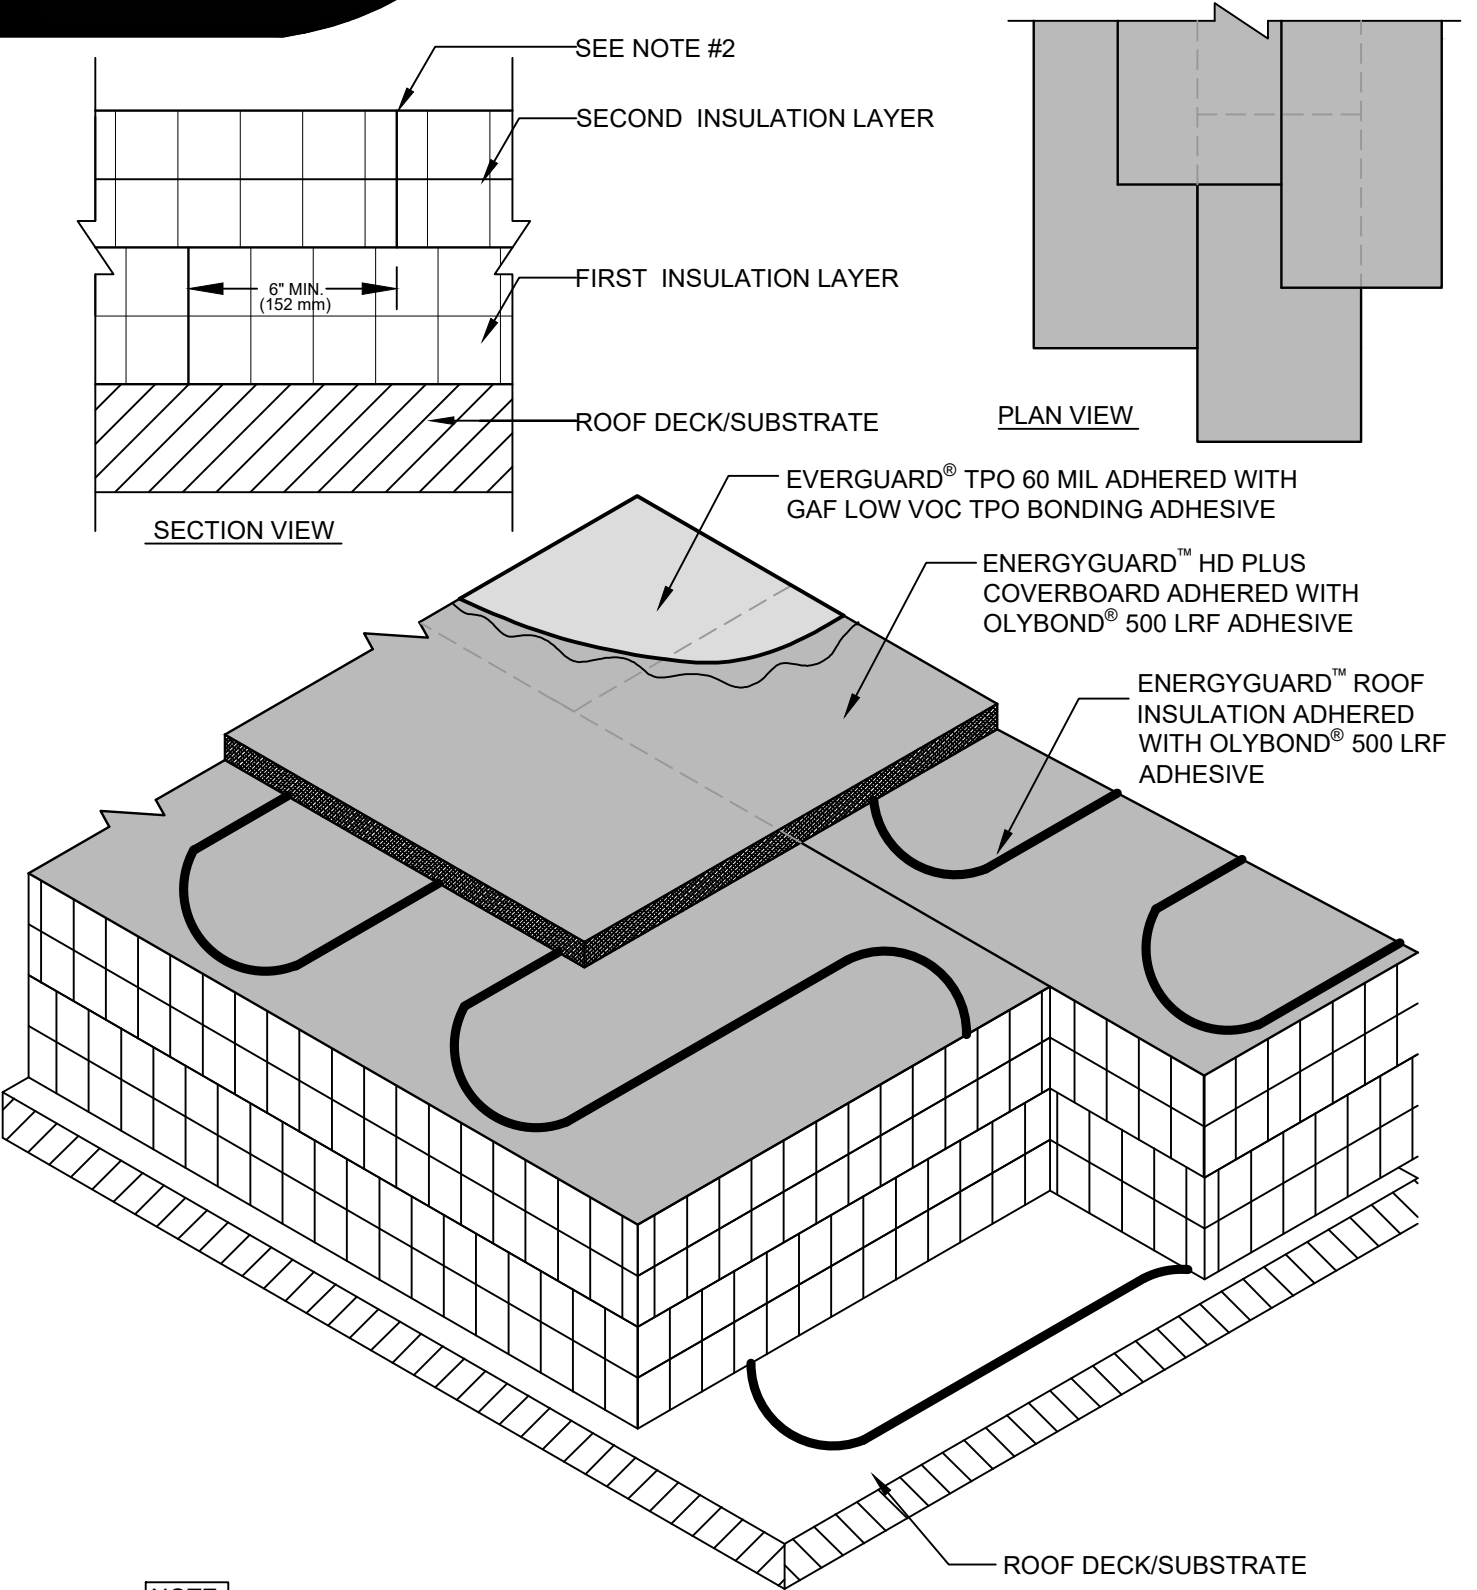

ADHERED SYSTEM LAYOUT DETAIL


DRAWING #  
1001

THIS DETAIL APPLIES TO:  
ADHERED SYSTEMS

ISSUE / REVISION DATE  
8/17/20

SCALE  
N.T.S.

LEGEND

 LOW VOC TPO BONDING ADHESIVE